



URBAN STANDARD SPECIFICATIONS for PUBLIC IMPROVEMENT MANUAL

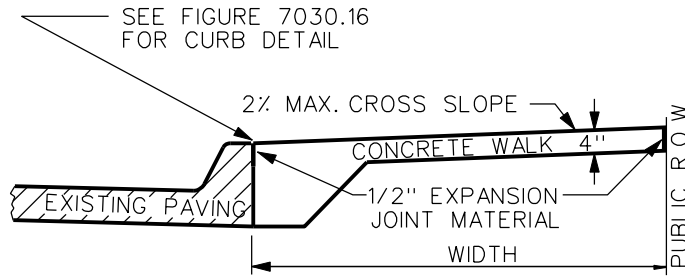


CLASS "A" SIDEWALK


(SIDEWALK EXTENDS FROM BACK OF CURB TO PUBLIC R.O.W.)

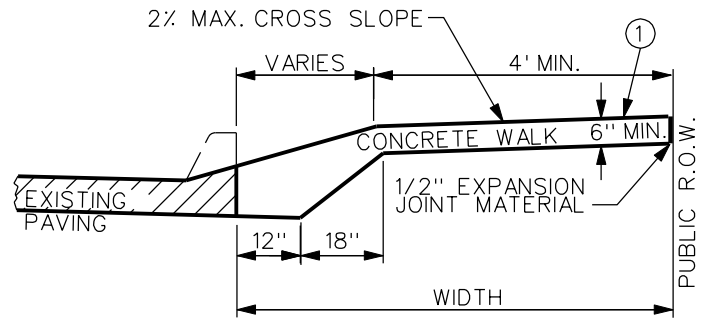

CLASS "A" SIDEWALK AT DRIVEWAY

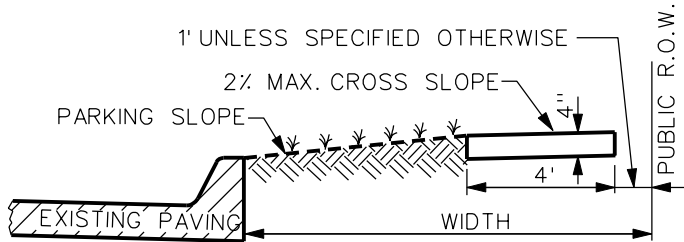


CLASS "B" SIDEWALK

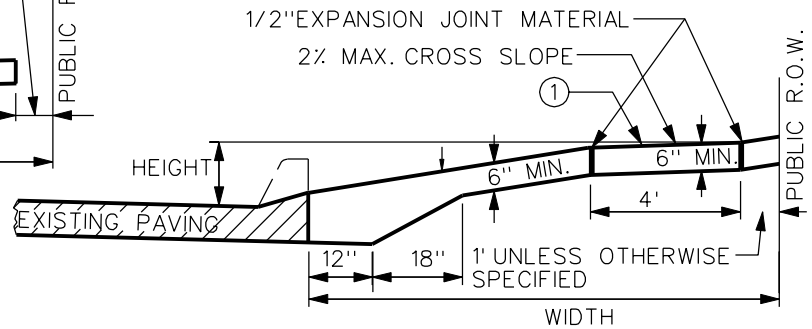


CLASS "B" SIDEWALK AT DRIVEWAY

(BACK OF SIDEWALK IS LOCATED 1' MIN. FROM PUBLIC R.O.W.)

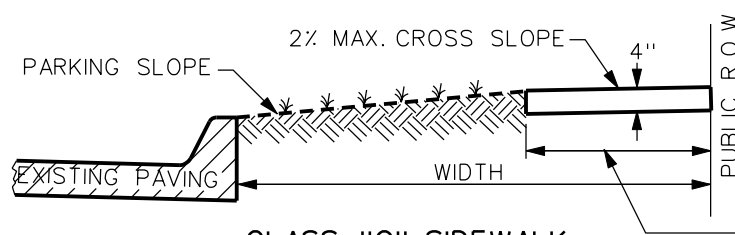

CLASS "C" SIDEWALK

(BACK OF SIDEWALK IS LOCATED ON PUBLIC R.O.W.)

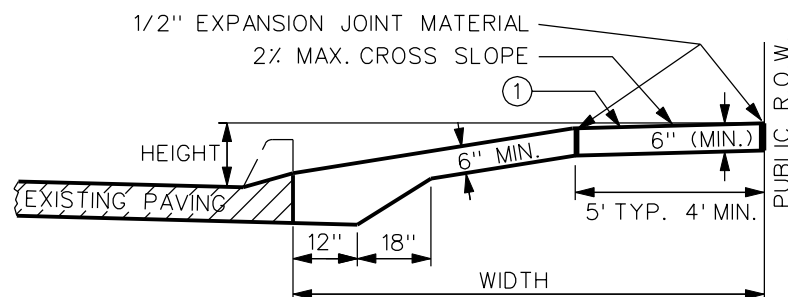

CLASS "C" SIDEWALK AT DRIVEWAY

PARKING SLOPES: CLASS B & C SIDEWALKS

LESS THAN 10 FEET WIDE: 1/4" PER FOOT (2% MIN.) (TYPICAL)

OVER 10 FEET WIDE: 1/2" PER FOOT (4%) (TYPICAL)

NOTE: SPECIAL GRADES MAY BE SPECIFIED FOR SOME STREETS

① SIDEWALK THICKNESS AT DRIVEWAY SHALL BE 6" MIN. OR THE THICKNESS OF THE DRIVEWAY, WHICHEVER IS GREATER.

2	01/29/03		
REV.	DATE	BY	
DATE: 01-01-98			
CLASSES OF SIDEWALKS AND RECREATIONAL TRAILS			FIGURE: 7030.8
			SHEET 1 OF 1